


VIEW AT CENTER SUPPORT
CENTER VESSEL ON 2 OR 3 SUPPORTS
AT SPAN(S) "S" : 3 SUPPORTS REQUIRED
FOR LENGTHS -4 AND OVER

| PORT SIZE CODE | |
|----------------|--------------------|
| D | 1 1/2" GROOVED END |
| E | 2" GROOVED END |
| F | 2 1/2" GROOVED END |

CAUTION: INCORRECT MANIFOLDING
WILL CAUSE SEVERE LOCAL STRESS
AROUND PORT AND MAY RESULT IN
LEAKS AND PREMATURE FAILURE;
TAKE EVERY PRECAUTION LISTED
ON REVERSE. SEE INSTALLATION
INSTRUCTIONS FOR FURTHER DETAILS

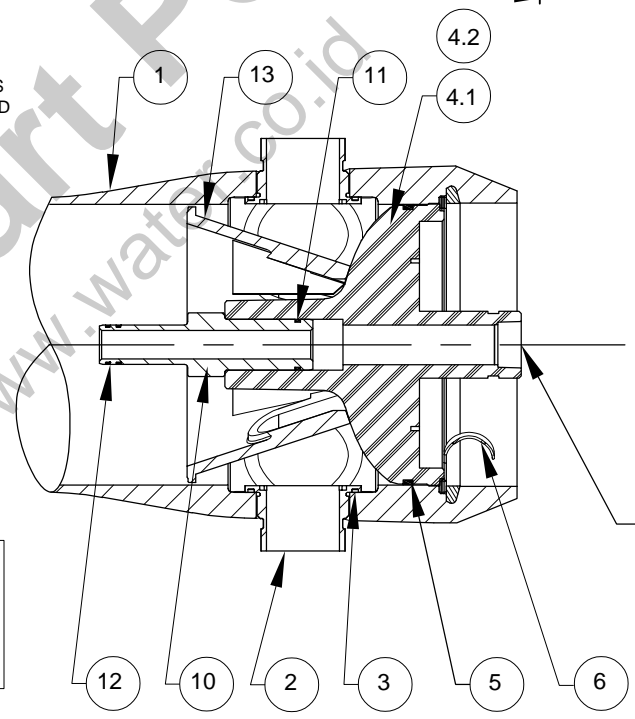

WARNING !
INTERNAL PORT PRESSURE
NOT TO EXCEED 125 PSI.

SECTION THROUGH END CLOSURE

| NO. OF PORTS | | PORT LOCATION | | | VESSEL QTY. |
|--------------|---------------|---------------|--------------|------------------------|-------------|
| | | | | | |
| Dash Length | L IN(MM) | P IN(MM) | S IN(MM) | Approx Weight LB(KG)** | |
| -1 | 59.75 (1518) | 47 (1194) | 20X1 (508) | 70 (32) | |
| -2 | 99.75 (2534) | 87 (2210) | 56X1 (1422) | 90 (41) | |
| -3 | 139.75 (3550) | 127 (3226) | 80X1 (2032) | 108 (49) | |
| -4 | 179.75 (4566) | 167 (4242) | 64X2 (1626) | 121 (55) | |
| -5 | 219.75 (5582) | 207 (5258) | 78X2 (1981) | 143 (65) | |
| -6 | 259.75 (6598) | 247 (6274) | 92X2 (2337) | 159 (72) | |
| -7 | 299.75 (7614) | 287 (7290) | 106X2 (2692) | 178 (81) | |
| -8 | 339.75 (8630) | 327 (8306) | 120X2 (3048) | 194 (88) | |

| DWG REF | QTY | PART NUMBER | DESCRIPTION | MATERIAL |
|-------------------|-----|-------------|---------------------------|---|
| SHELL | | | | |
| 1 | 1 | 99231 | SHELL | Filament Wound Epoxy/Glass composites - Head locking grooves integrally wound in place. |
| 2 | A/R | A/R | F/C Port | SA-351 CF3M |
| 3 | A/R | A/R | F/C Port Seal | Ethylene Propylene . |
| HEAD - NON CODED | | | | |
| 4 | 2 | 96248 | Elliptical Head Assy. | Engineering Thermoplastic. |
| 4.1 | 2 | 194441 | Elliptical Head | Engineering Thermoplastic. |
| 4.2 | 2 | 96166 | Danger Label | - |
| 5 | 2 | 196223 | Head Seal | Ethylene Propylene - O - Ring |
| HEAD INTERLOCK | | | | |
| 6 | 2 | 47336 | Quick Release Spiral Ring | SA-479 SS316 |
| VESSEL SUPPORT | | | | |
| 7 | 2* | 52169 | Saddle | Engineering Thermoplastic. |
| 8 | 2* | 45042 | Strap Assy. | 304 Stainless Steel-PVC Cushion. |
| 9 | 4** | 46265 | Strap screw. | 5/16-18 UNC,2.5" L, 304 Stainless Steel. |
| ELEMENT INTERFACE | | | | |
| 10 | 2 | A/R | Adapter | Engineering Thermoplastic. |
| 11 | 2 | 196222 | Adapter seal | Ethylene Propylene - O - Ring |
| 12 | 4 | A/R | PWT Seal | Ethylene Propylene - O - Ring |
| 13 | 1 | 97014 | Thrust Cone | Engineering Thermoplastic. |


*3 & **6 each furnished with length code 4,5,6,7 & 8.

GENERAL NOTES:
1. MAX. ANGULAR VARIATION BETWEEN ANY PORT ±0.5".
2. DIMENSION IN INCHES (MM APPROX.).
3. SHELL EXTERIOR COATED WITH WHITE RAL 9003, HIGH GLOSS POLYURETHANE PAINT.
4. ITEM 13 DOWNSTREAM ONLY.
5. NOT TO BE USED FOR CONSTRUCTION UNLESS CERTIFIED BY PENTAIR.
** WEIGHTS GIVEN IN THE TABLE ARE FOR HIGHEST CONFIGURATION AND WILL VARY WITH CHANGE IN CONFIGURATION.

THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN, ARE THE CONFIDENTIAL AND PROPRIETARY INFORMATION OF PENTAIR WATER INDIA PVT. LTD. PENTAIR WATER INDIA PVT. LTD. IS THE SOLE OWNER OF THE INFORMATION AND PROCESSES DEFINED HEREIN. THIS DOCUMENT, AND THE INFORMATION CONTAINED, MAY NOT BE DISCLOSED, REPRODUCED, DUPLICATED, USED, SOLD, PUBLISHED, COMMUNICATED OR OTHERWISE DISTRIBUTED, IN WHOLE OR IN PART, FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN CONSENT OF PENTAIR WATER INDIA PVT. LTD. THIS DOCUMENT AND ANY COPIES, IN ALL APPLICABLE FORMATS, SHALL BE RETURNED TO PENTAIR WATER INDIA PVT. LTD. UPON REQUEST.

ALL INDICATED PENTAIR TRADEMARKS AND LOGOS ARE PROPERTY OF PENTAIR. THIRD PARTY REGISTERED AND UNREGISTERED TRADEMARKS AND LOGOS ARE PROPERTY OF THEIR RESPECTIVE OWNERS. BECAUSE WE ARE CONTINUOUSLY IMPROVING OUR PRODUCTS AND SERVICES, PENTAIR RESERVES THE RIGHT TO CHANGE SPECIFICATIONS WITHOUT PRIOR NOTICE. PENTAIR IS AN EQUAL OPPORTUNITY EMPLOYER.

© 2021 Pentair. All Rights Reserved.



PENTAIR
CODELINE

VERNA, GOA
INDIA

| | | | |
|--------------------|--|---------------------------------|--------------------|
| DRAWN BY: KR | DRAWING DESCRIPTION: MODEL - 80S45 NC MEMBRANE HOUSING | DRAWING NO.: 99173 | REV.: U |
| DATE: 27DEC07 | CUSTOMER NAME: - | VESSEL MODEL: 80S45 (NON-CODED) | |
| CHECKED BY: MD | PROJECT NAME: - | TOTAL QTY: - | |
| DATE: 27DEC07 | CUSTOMER P.O.#: - | SIZE: A3 | SCALE: NONE |
| ECN NO.: 6242 | | | PAGE NO.: 01 OF 02 |
| REV. DATE: 10NOV22 | | | |



PT Watermart Perkasa
Email: sales@water.co.id Phone: +62-21-316-1671
Whatsapp (text only): +62815-8609-3500
Website: www.water.co.id

RATING:

| | |
|-----------------------------|-------------------------|
| DESIGN PRESSURE..... | 450 PSIG (3.10 MPa) |
| MAX. OPERATING TEMP | 190°F (88°C) |
| MIN. OPERATING TEMP..... | 20°F (-7°C) |
| FACTORY TEST PRESSURE..... | 675 PSIG (4.65 MPa) |
| QUALIFICATION PRESSURE..... | 2700 PSI (18.62 MPa) |

INTENDED USE:

The CodeLine 80S45 Non Coded Fiberglass RO Pressure Vessel is designed for continuous, long term use as housing for reverse osmosis membrane elements to desalt typical brackish waters at pressures up to 450 psi. Any make of eight-inch nominal diameter spiral-wound element is easily accommodated; the appropriate interfacing hardware for the element specified is furnished with the vessel.

The Shell of CodeLine 80S45 Non Coded vessel is designed in accordance with the engineering standards of the Boiler and Pressure Vessel Code of the American Society of Mechanical Engineers (ASME) as per Section X Edition 2021 and all metallic parts are designed as per ASME section VIII Division I Edition 2021.

The CodeLine 80S45 Non Coded vessel must be installed operated and maintained in accordance with the listed precautions and good industrial practice to assure safe operation over a long service life.

The high performance Filament wound FRP shell must be allowed to expand under pressure; undue restraint at support points or piping connections can cause leaks to develop in the shell. This side-ported vessel requires special precautions in mounting and connection to piping so that the vessel will not be subjected to excessive stress due to bending moments acting at the side openings in the fiberglass shell. The end closure, incorporating close fitting, interlocking metal components, must be kept dry and free of corrosion; deterioration can lead to catastrophic mechanical failure of the head.

Pentair will assist the purchaser in determining the suitability of this standard vessel for their specific operating conditions. The final determination however, including evaluation of the standard material of construction for compatibility with the specific corrosive environment, shall be the responsibility of the purchaser. Alternate materials with enhanced corrosion resistance are available on special order.

Specifications are subject to change without notice.

PRECAUTIONS:

- DO...read, understand and follow all instructions; failure to take every precaution will void warranty and may result in vessel failure
- DO...mount the shell on horizontal members at span “S” using compliant vessel supports furnished; Shim saddles if required. Tighten hold down straps just snug
- DO...align and center side ports with the manifold header. Correct, causes of misalignment in a row of vessels connected to the same header
- DO...use flexible type IPS grooved-end pipe couplings, at side ports; allow full, 0.125 inch gap between port and piping, and position piping to maximize flexibility of connection.
- DO...provide flexibility in, and support for piping manifolds so that vessel can grow in length under pressure without undue restraint; provide additional flexible joints in large pipes leading to manifold header.
- DO...provide overpressure protection for vessel set at not more than 105% of design pressure
- DO...inspect end closures regularly; replace components that have deteriorated and correct causes of corrosion
- DO... Lubricate seals sparingly, using nonpetroleum Based lubricants, i.e. Parker Super O-lube®, Glycerin or suitable silicone based lubricants.

- DO NOT...work on any component until first verifying that pressure is relieved from vessel
- DO NOT...make rigid piping connections to ports or clamp vessel in any way that resists growth of fiberglass shell under pressure; ***ΔDIA = 0.015 in. (0.4mm) and ***ΔL = 0.2 in. (6mm) for a length code –8 vessel
- DO NOT... hang piping manifolds from ports or use vessel in any way to support other components
- DO NOT...tighten Permeate Port connection more than one turn past hand tight
- DO NOT... operate vessel without connecting both Permeate Ports internally to complete set of elements or otherwise plug ports internally so that external piping connection is not subjected to feed pressure
- DO NOT...install Spacer on downstream end of vessel
- DO NOT...operate vessel without Thrust Cone installed downstream
- DO NOT...pressurize vessel until double-checking to verify that the Locking Ring is in place and fully seated.
- DO NOT...operate vessel at pressure and temperature in excess of its rating.
- DO NOT...operate vessel with permeate pressure in excess of 125 psi at 190°F (0.86 MPa at 88°C).
- DO NOT...tolerate leaks or allow end closures to be routinely wetted in any way
- DO NOT...operate outside the pH range 3-11.

For complete information on proper use of the vessel
Please refer to the 80S Series USER'S GUIDE 94182.

ORDERING:

Using the chart below, please check the features you require

VESSEL LENGTH CODE – please check one

MODEL 80S45 Non Coded ☐ -1 ☐ -2 ☐ -3 ☐ -4 ☐ -5 ☐ -6 ☐ -7 ☐ -8

MEMBRANE BRAND AND MODEL

- ☐ Please supply adapters for the following membrane brand and specific model
Brand _____ Model _____

CERTIFICATION REQUIRED

- ☐ Certified By Pentair.

PERMEATE PORT CONFIGURATION:

- ☐ Standard. 1” FNPT & 1.5” IPS GROOVED NORYL HEAD.
☐ Optional .1” BSP F/JIS F Parallel Thread & 1.5” IPS GROOVED

STRAP ASSEMBLY

- ☐ Standard SS304 ☐ Optional SS316 ☐ Optional SS316L

| STRAP ASSEMBLY PART NUMBERS | | |
|-----------------------------|--------------------|--------------------|
| SS304 | SS316 | SS316L |
| 45042 | 46926 ⁺ | 94371 ⁺ |


FEED/CONCENTRATE PORT SELECTION

- Material of Construction ☐ Standard CF3M ☐ Optional Duplex SS (CD3MN)
☐ Optional Super Duplex SS (CD3MWCuN)

- Configuration ☐ Standard - CF3M 1D5D
☐ Optional – Multi ports :
2.5” Ports not available in 90° Configuration.

| | | | | | | | |
|-------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|
| Serial number end | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Opposite end | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

| F/C PORT & SEAL PART NUMBER | | | | |
|-----------------------------|-------|---------|-------------|--------|
| SIZE | *CF3M | **CD3MN | ***CD3MWCuN | SEAL |
| 1.5" | 98024 | 97353 | 96507 | 196224 |
| 2.0" | 98025 | 97357 | 96643 | 196225 |
| 2.5" | 98026 | 97364 | 96556 | 196226 |

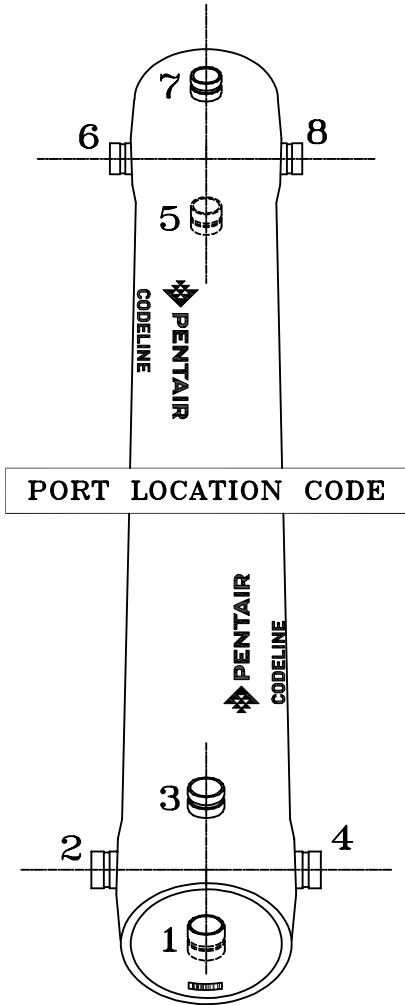

CODILINE BODY LABELS ARE PLACED AT 90° ON SERIAL NUMBER END AND AT 270° ON THE OPPOSITE SIDE END

GENERAL NOTES:

- DIMENSIONS IN INCHES (MM APPROX.).
- * GRADE SA-351 CF3M.
 - ** GRADE SA-995 CD3MN (UNS J92205).
 - *** GRADE SA-995 CD3MWCuN (UNS J93380)
 - + OPTIONAL STRAP ASSEMBLY WITH SS-316 & 316L SHALL BE SUPPLIED AS PER METRIC STANDARDS.

THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN, ARE THE CONFIDENTIAL AND PROPRIETARY INFORMATION OF PENTAIR WATER INDIA PVT. LTD. PENTAIR WATER INDIA PVT. LTD. IS THE SOLE OWNER OF THE INFORMATION AND PROCESSES DEFINED HEREIN. THIS DOCUMENT, AND THE INFORMATION CONTAINED, MAY NOT BE DISCLOSED, REPRODUCED, DUPLICATED, USED, SOLD, PUBLISHED, COMMUNICATED OR OTHERWISE DISTRIBUTED, IN WHOLE OR IN PART, FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN CONSENT OF PENTAIR WATER INDIA PVT. LTD. THIS DOCUMENT AND ANY COPIES, IN ALL APPLICABLE FORMATS, SHALL BE RETURNED TO PENTAIR WATER INDIA PVT. LTD. UPON REQUEST.

ALL INDICATED PENTAIR TRADEMARKS AND LOGOS ARE PROPERTY OF PENTAIR. THIRD PARTY REGISTERED AND UNREGISTERED TRADEMARKS AND LOGOS ARE PROPERTY OF THEIR RESPECTIVE OWNERS. BECAUSE WE ARE CONTINUOUSLY IMPROVING OUR PRODUCTS AND SERVICES, PENTAIR RESERVES THE RIGHT TO CHANGE SPECIFICATIONS WITHOUT PRIOR NOTICE. PENTAIR IS AN EQUAL OPPORTUNITY EMPLOYER.

© 2021 Pentair. All Rights Reserved.



PENTAIR
CODILINE

VERNA, GOA
INDIA

| | | | | |
|--------------|---------|-----------------------------------|-------------------|-----------|
| DRAWN BY: | KR | DRAWING DESCRIPTION: | DRAWING NO.: | REV.: |
| DATE: | 27DEC07 | MODEL - 80S45 NC MEMBRANE HOUSING | 99173 | U |
| CHECKED BY: | MD | CUSTOMER NAME: | VESSEL MODEL: | |
| DATE: | 27DEC07 | - | 80S45 (NON-CODED) | |
| APPROVED BY: | SS | PROJECT NAME: | TOTAL QTY: | |
| DATE: | 27DEC07 | - | - | |
| ECN NO.: | 6242 | CUSTOMER P.O.#: | SIZE: | SCALE: |
| REV. DATE: | 10NOV22 | - | A3 | NONE |
| | | | | PAGE NO.: |
| | | | | 02 OF 02 |



PT Watermart Perkasa
Email: sales@water.co.id Phone: +62-21-316-1671
Whatsapp (text only): +62815-8609-3500
Website: www.water.co.id